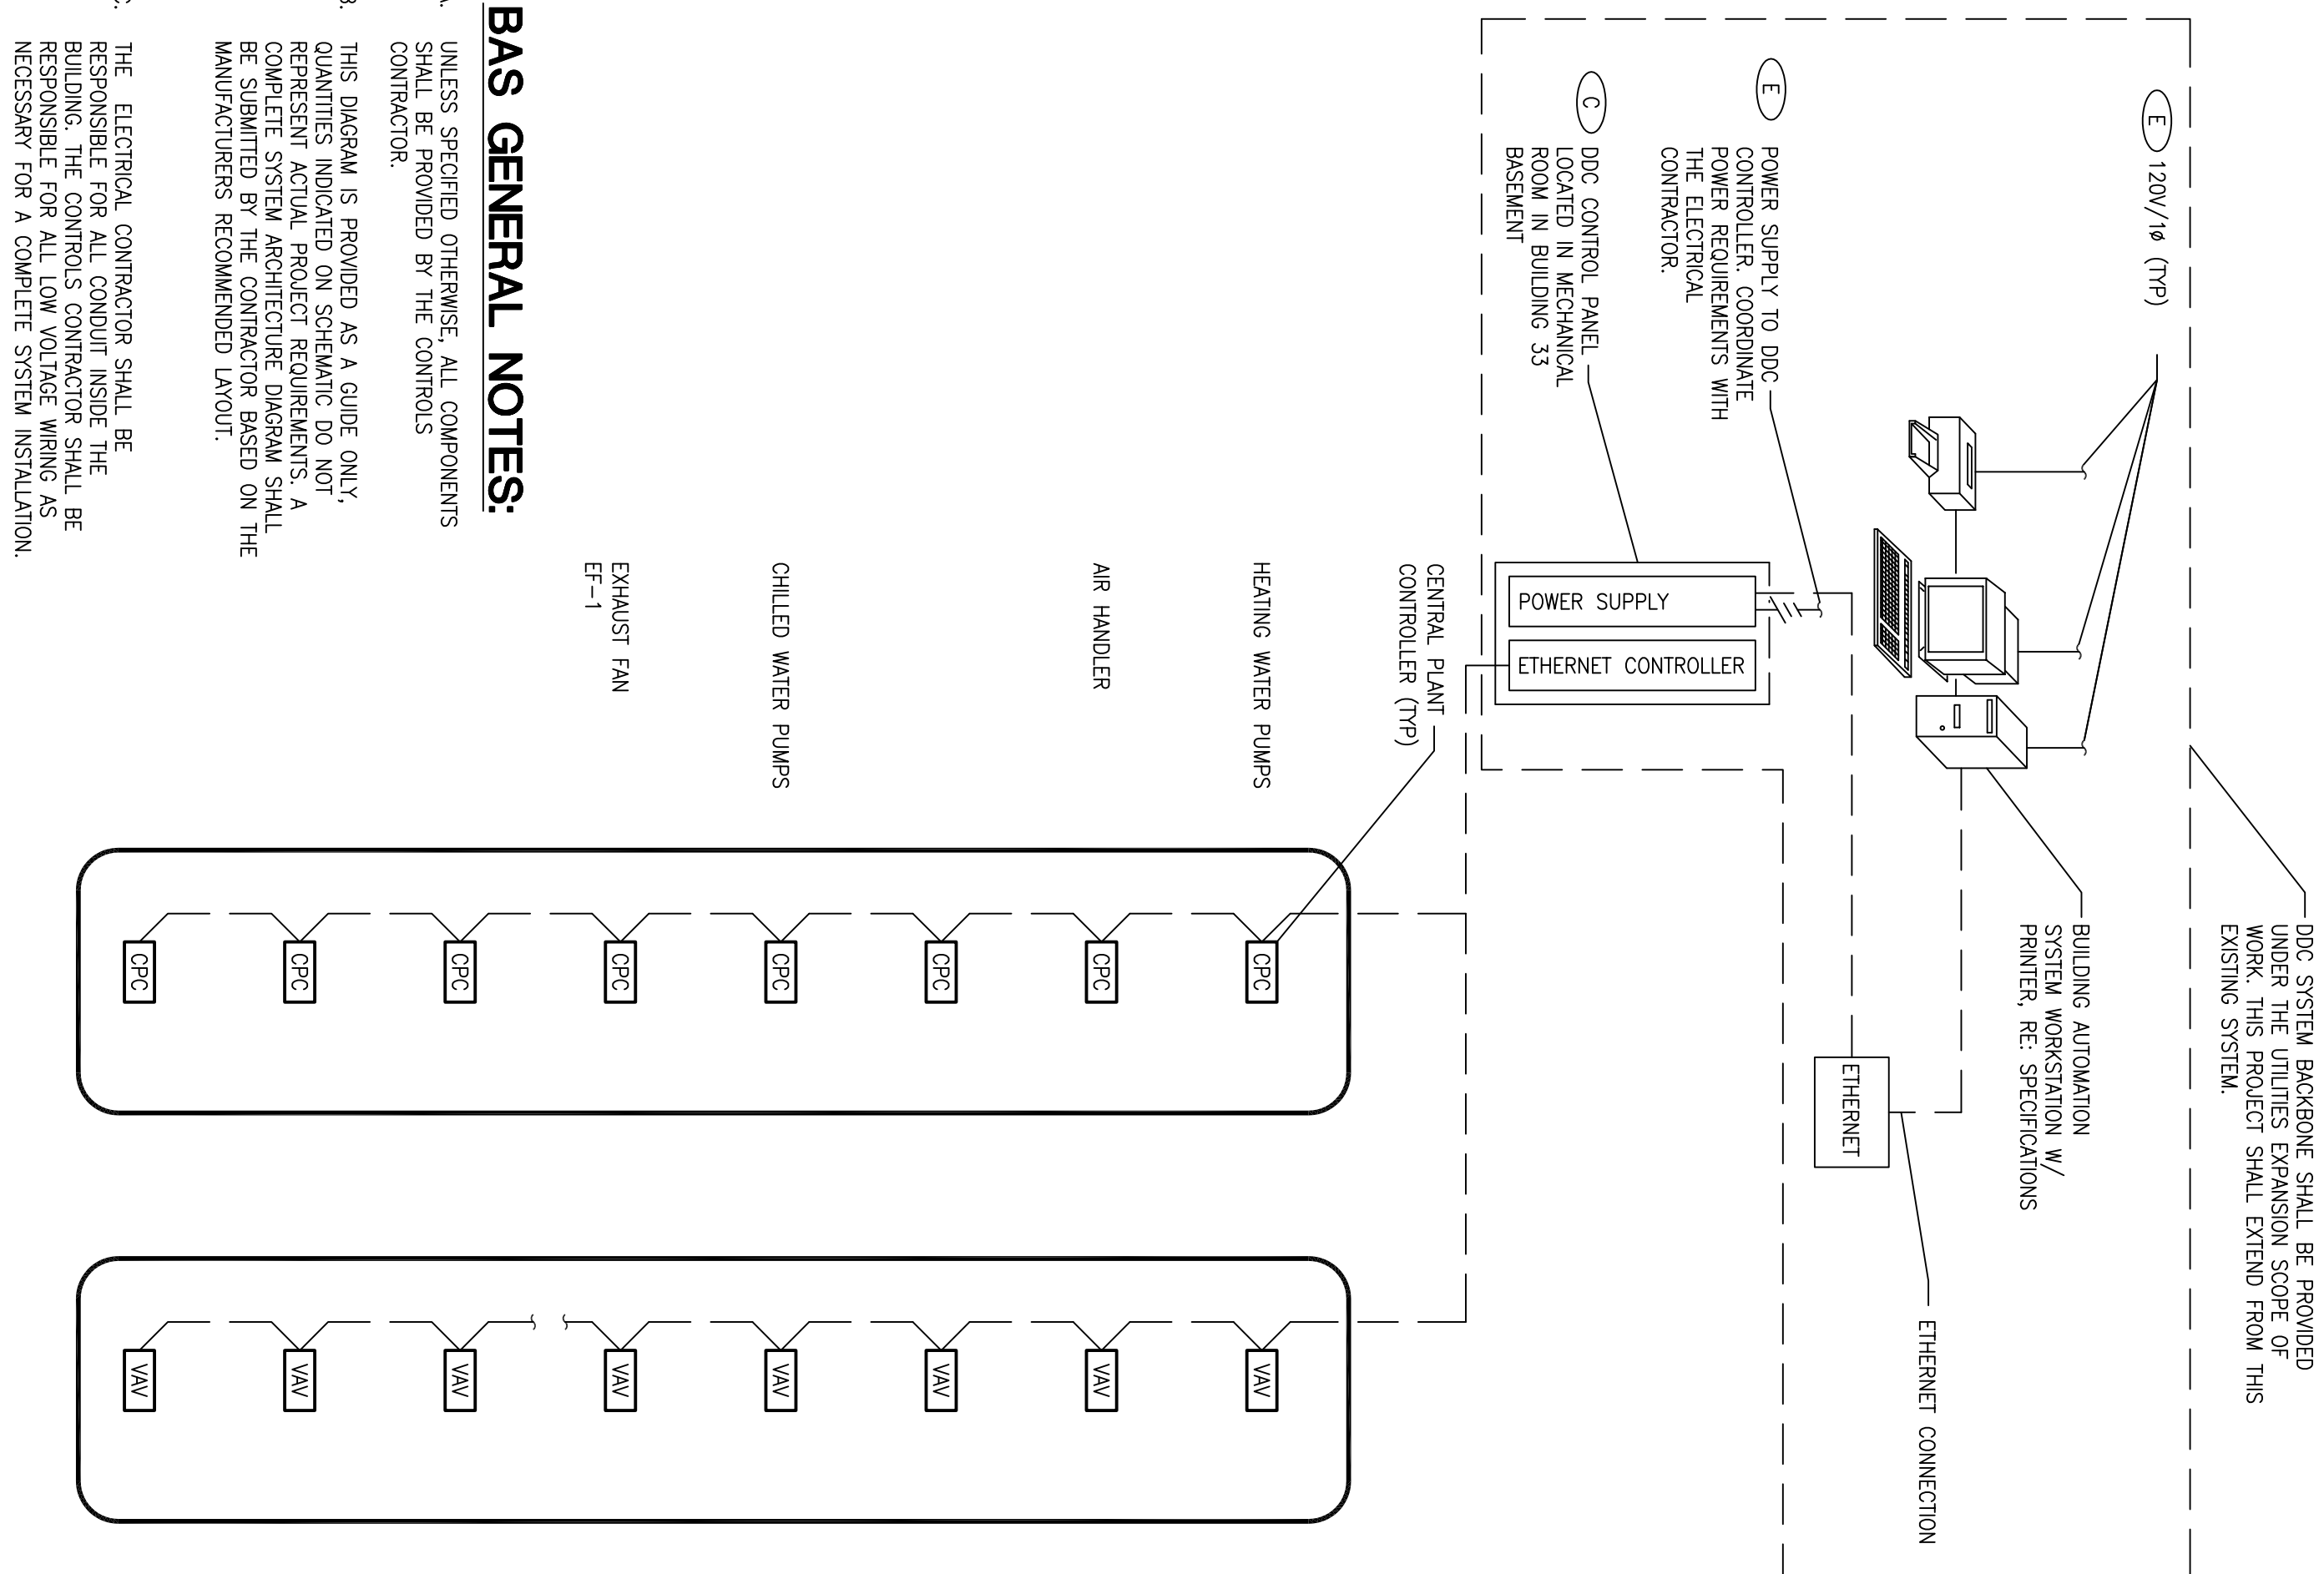


[illegible]


BUILDING AUTOMATIC SYSTEM ARCHITECTURE DIAGRAM

BAS GENERAL NOTES:

A. UNLESS SPECIFIED OTHERWISE, ALL COMPONENTS SHALL BE PROVIDED BY THE CONTRACTOR.

B. THIS DIAGRAM IS PROVIDED AS A GUIDE ONLY, DIMENSIONS INDICATED ON SPEAKER AND NOT ON THE WIRING DIAGRAM SHALL BE USED TO COMPLETE SYSTEM ARCHITECTURE. DIAGRAM SHALL BE SUBMITTED BY THE CONTRACTOR BASED ON THE MANUFACTURERS RECOMMENDED LAYOUT.

C. THE ELECTRICAL CONTRACTOR SHALL BE RESPONSIBLE FOR THE WIRING OF THE BUILDING. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL LOW VOLTAGE WIRING AS NECESSARY FOR A COMPLETE SYSTEM INSTALLATION.

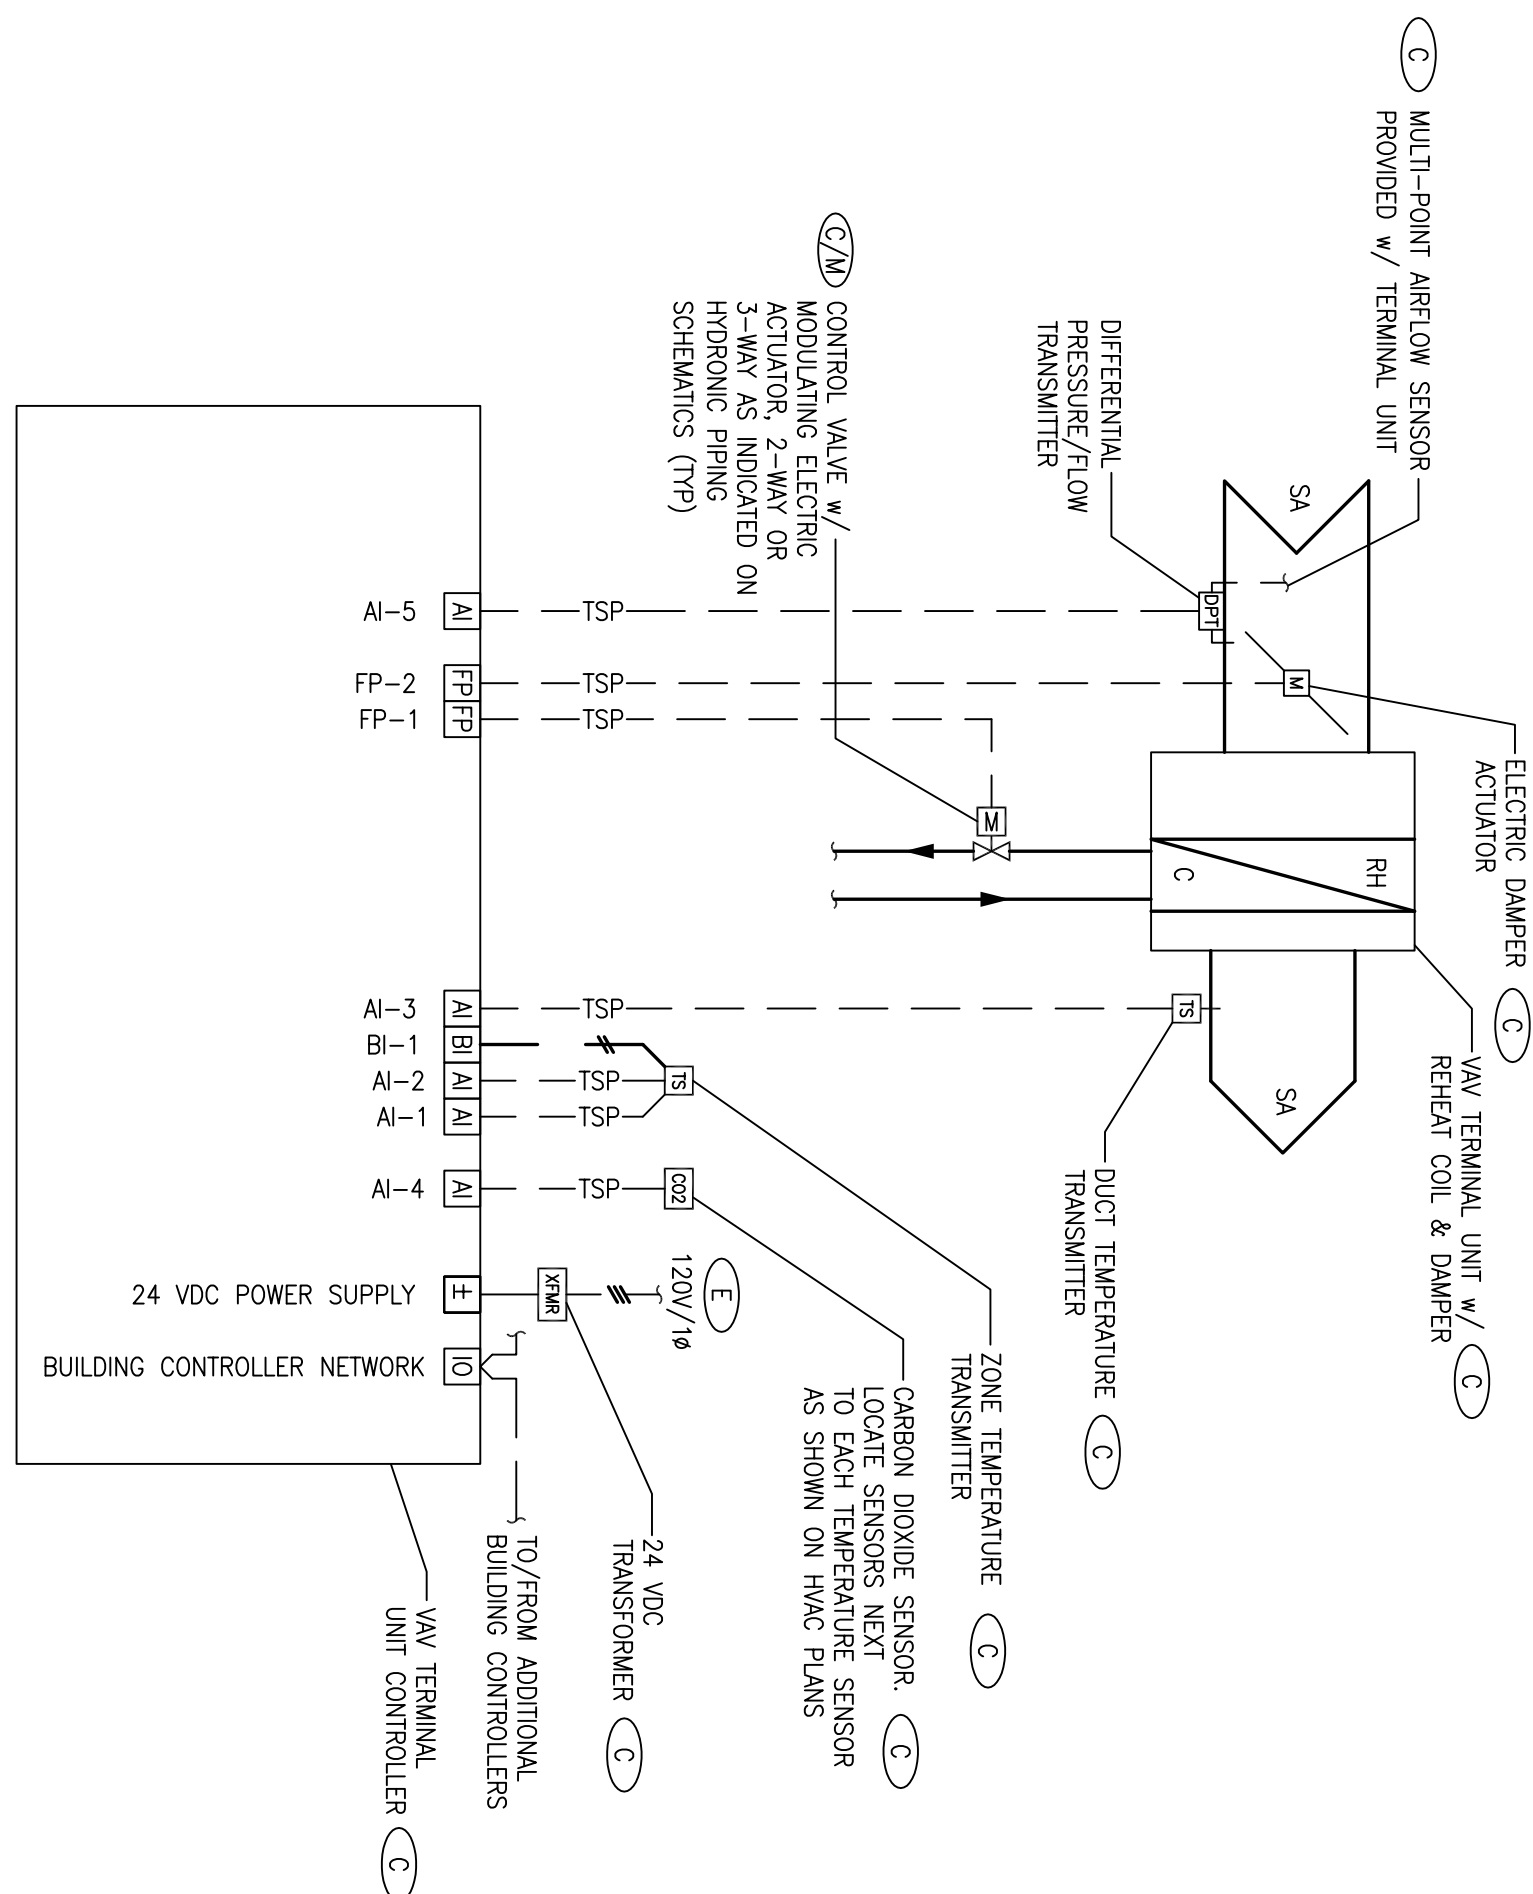

2 VAV TERMINAL WITH REHEAT CONTROL SCHEMATIC & POINTS LIST

[illegible]